


CUT-OUT	CUT-OUT DIMENSIONS (H x W x D)	MINIMUM DUCT SIZE (SEE EDS 08-2101)
100A 1-PHASE	202 x 117 x 92	32
		125 ROAD CROSSING
100A 3-PHASE	256 x 195 x 92	50
		125 ROAD CROSIING

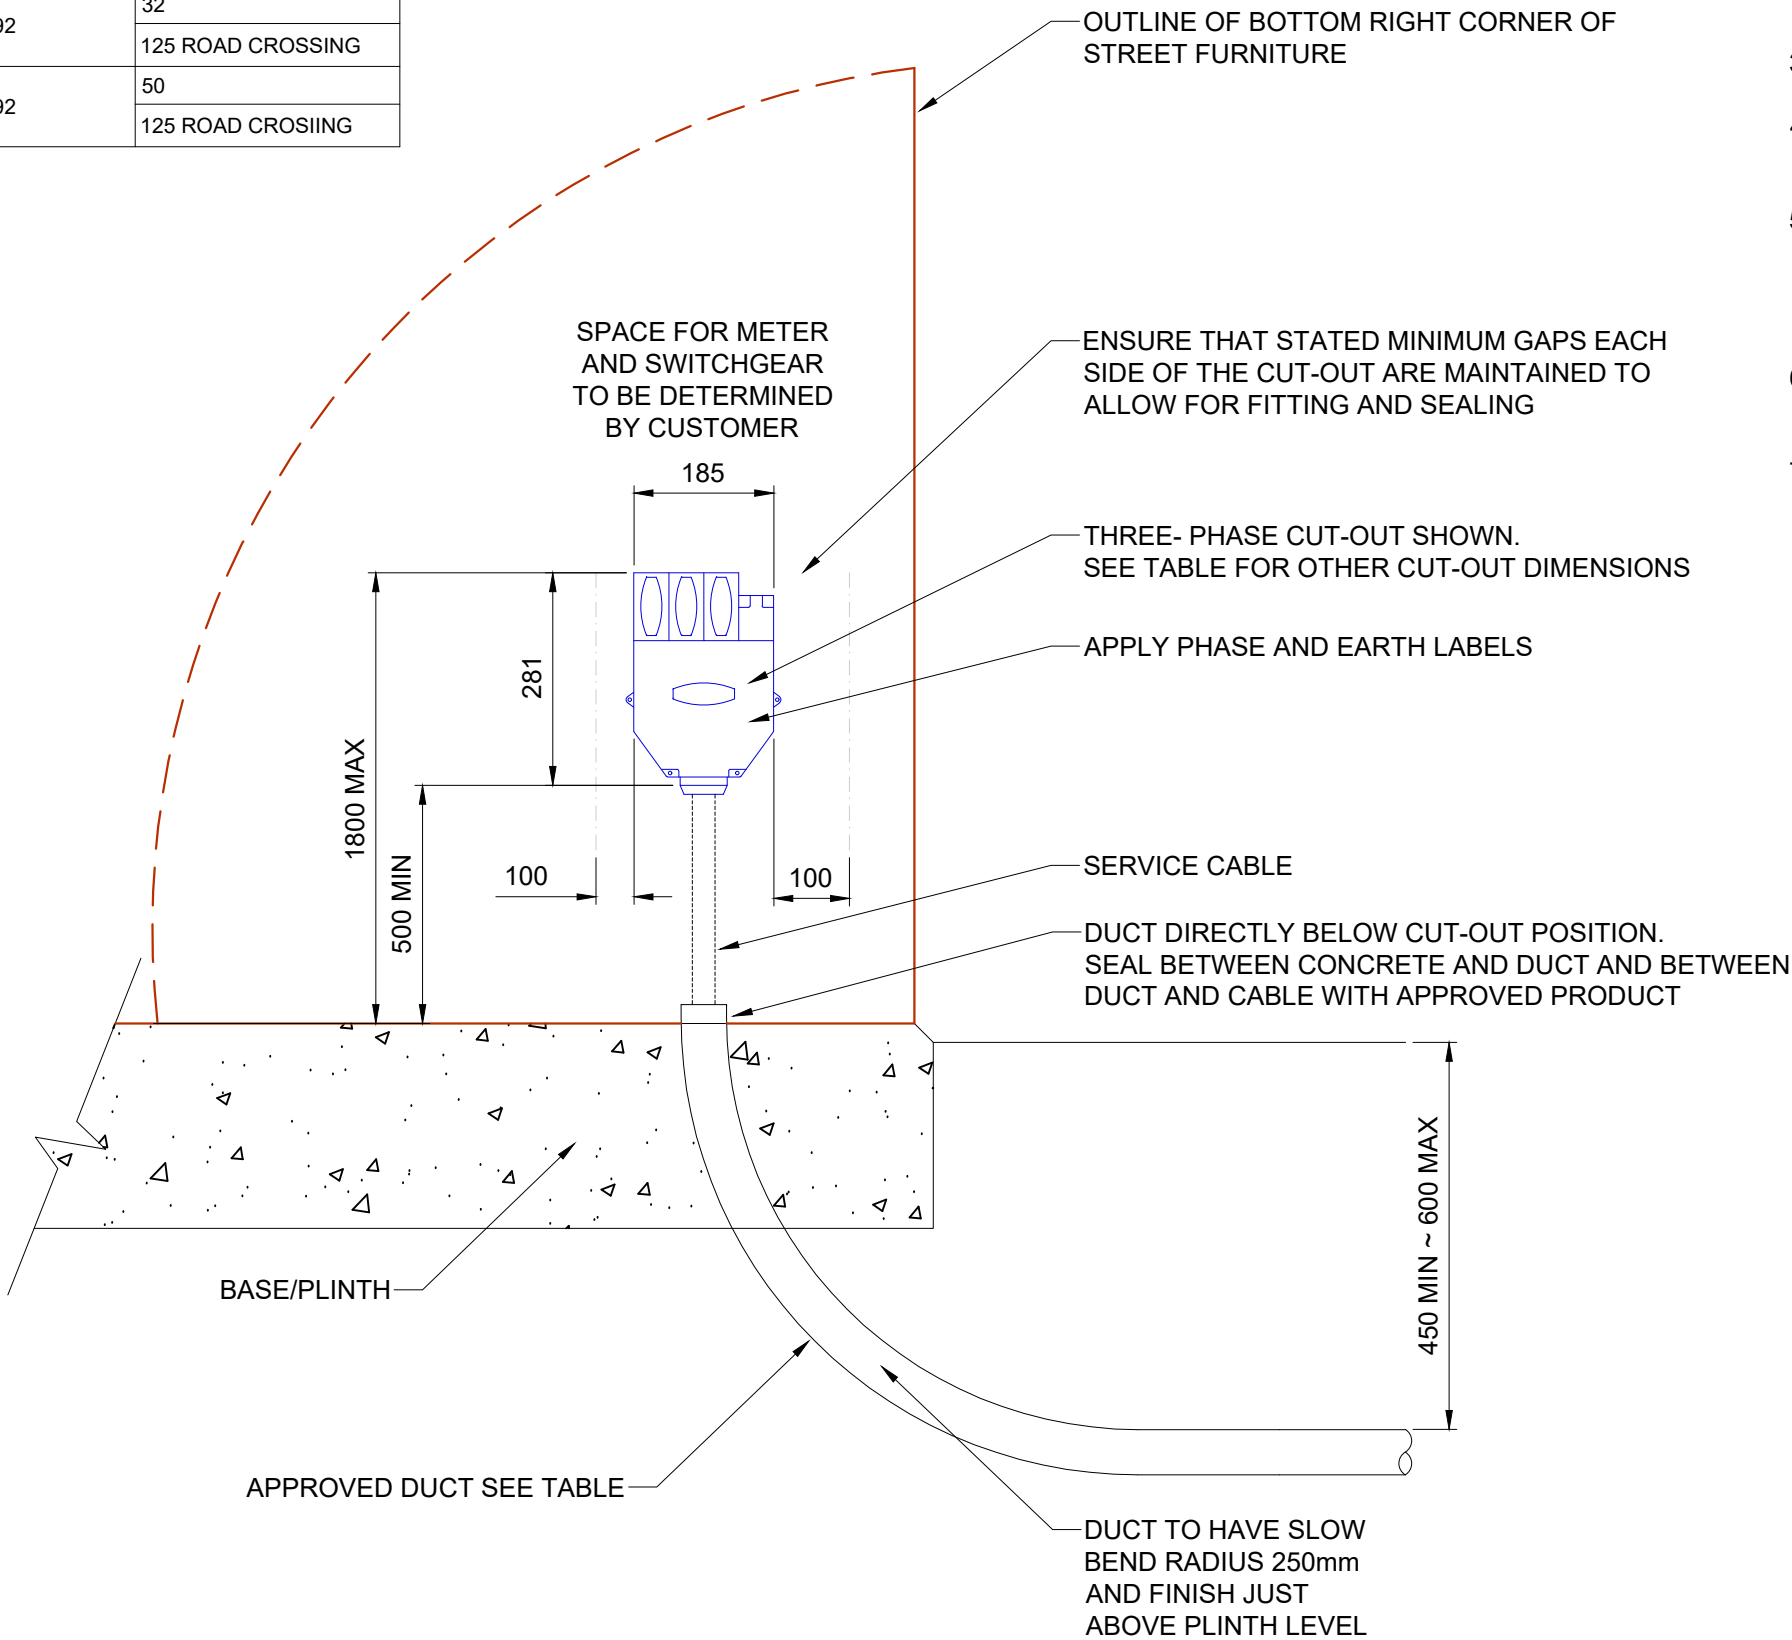

- NOTES**
1. ALL DIMENSIONS IN MILLIMETRES.
 2. ENCLOSURE AND BASE TO CUSTOMER/MANUFACTURER SPECIFICATION.
 3. CUSTOMER TO PROVIDE AND INSTALL DUCT WITH DRAW CORD.
 4. ENCLOSURE TO BE WEATHERPROOF AND SECURE BEFORE THE INSTALLATION OF UK POWER NETWORKS EQUIPMENT.
 5. MINIMUM CLEARANCES:
 - 1000mm WORKING SPACE IN FRONT OF CUT-OUT.
 - 2000mm OPERATIONAL HEADROOM (IN FRONT OF CUT OUT).
 6. CUT-OUT ACCEPTS 25-35mm² CUSTOMER CABLES. CUT-OUT IS NOT DESIGNED FOR ARMoured OR TRI-RATED CABLES.
 7. DNO EARTHING PROVISION TO BE IN ACCORDANCE WITH EDS 06-0017.

			
TITLE			
100A CUT-OUT ARRANGEMENT METERED STREET FURNITURE			
SCALE 1:10		@A3	03/03/2025
DRAWING NO.			Version
EDS 08-2110-15a			08
STD LV ELECTRICAL SERVICES			