



CUT-OUT	CUT-OUT DIMENSIONS (H x W x D)	MINIMUM DUCT SIZE (SEE EDS 08-2101)
100A 1-PHASE	202 x 117 x 92	32
		125 ROAD CROSSING
100A 3-PHASE	256 x 195 x 92	50
		125 ROAD CROSSING

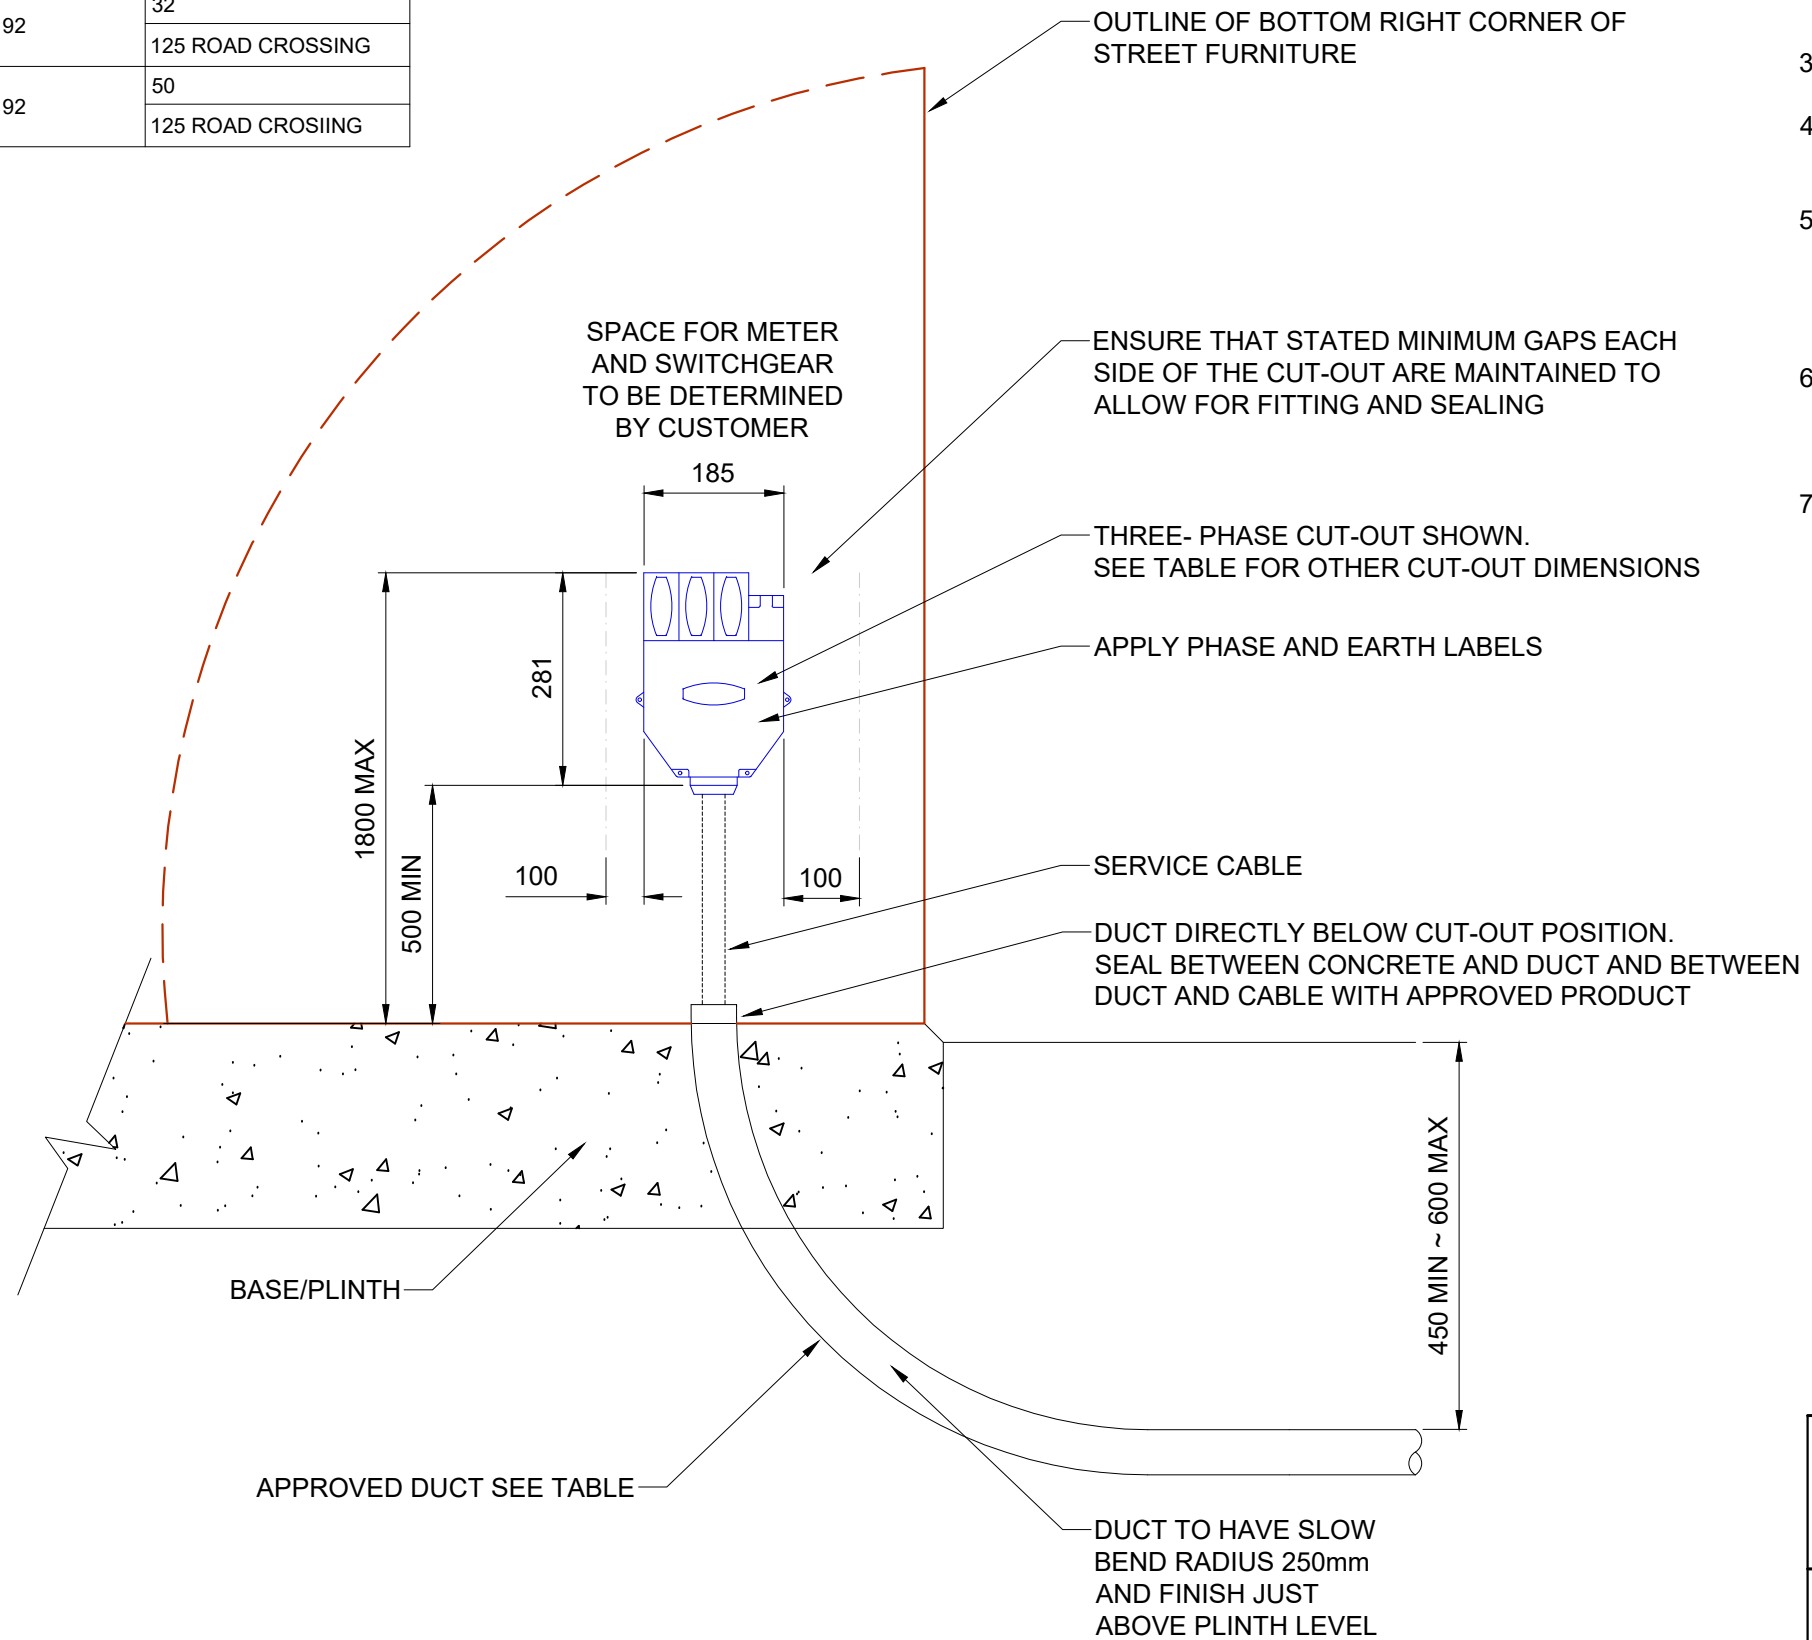

NOTES

1. ALL DIMENSIONS IN MILLIMETRES.
2. ENCLOSURE AND BASE TO CUSTOMER/MANUFACTURER SPECIFICATION.
3. CUSTOMER TO PROVIDE AND INSTALL DUCT WITH DRAW CORD.
4. ENCLOSURE TO BE WEATHERPROOF AND SECURE BEFORE THE INSTALLATION OF UK POWER NETWORKS EQUIPMENT.
5. MINIMUM CLEARANCES:
 - 1000mm WORKING SPACE IN FRONT OF CUT-OUT.
 - 2000mm OPERATIONAL HEADROOM (IN FRONT OF CUT OUT).
6. CUT-OUT ACCEPTS 25-35mm² CABLES. CUT-OUT IS NOT DESIGNED FOR CLASS 5/6 FLEXIBLE CONDUCTORS OR ARMoured CABLES. REFER TO EDS 08-2101.
7. DNO EARTHING PROVISION TO BE IN ACCORDANCE WITH EDS 06-0017.

		
TITLE 100A CUT-OUT ARRANGEMENT METERED STREET FURNITURE		
SCALE 1:10	@A3	01/12/2025
DRAWING NO.		Version
EDS 08-2110-15a		09
STD	LV ELECTRICAL SERVICES	